


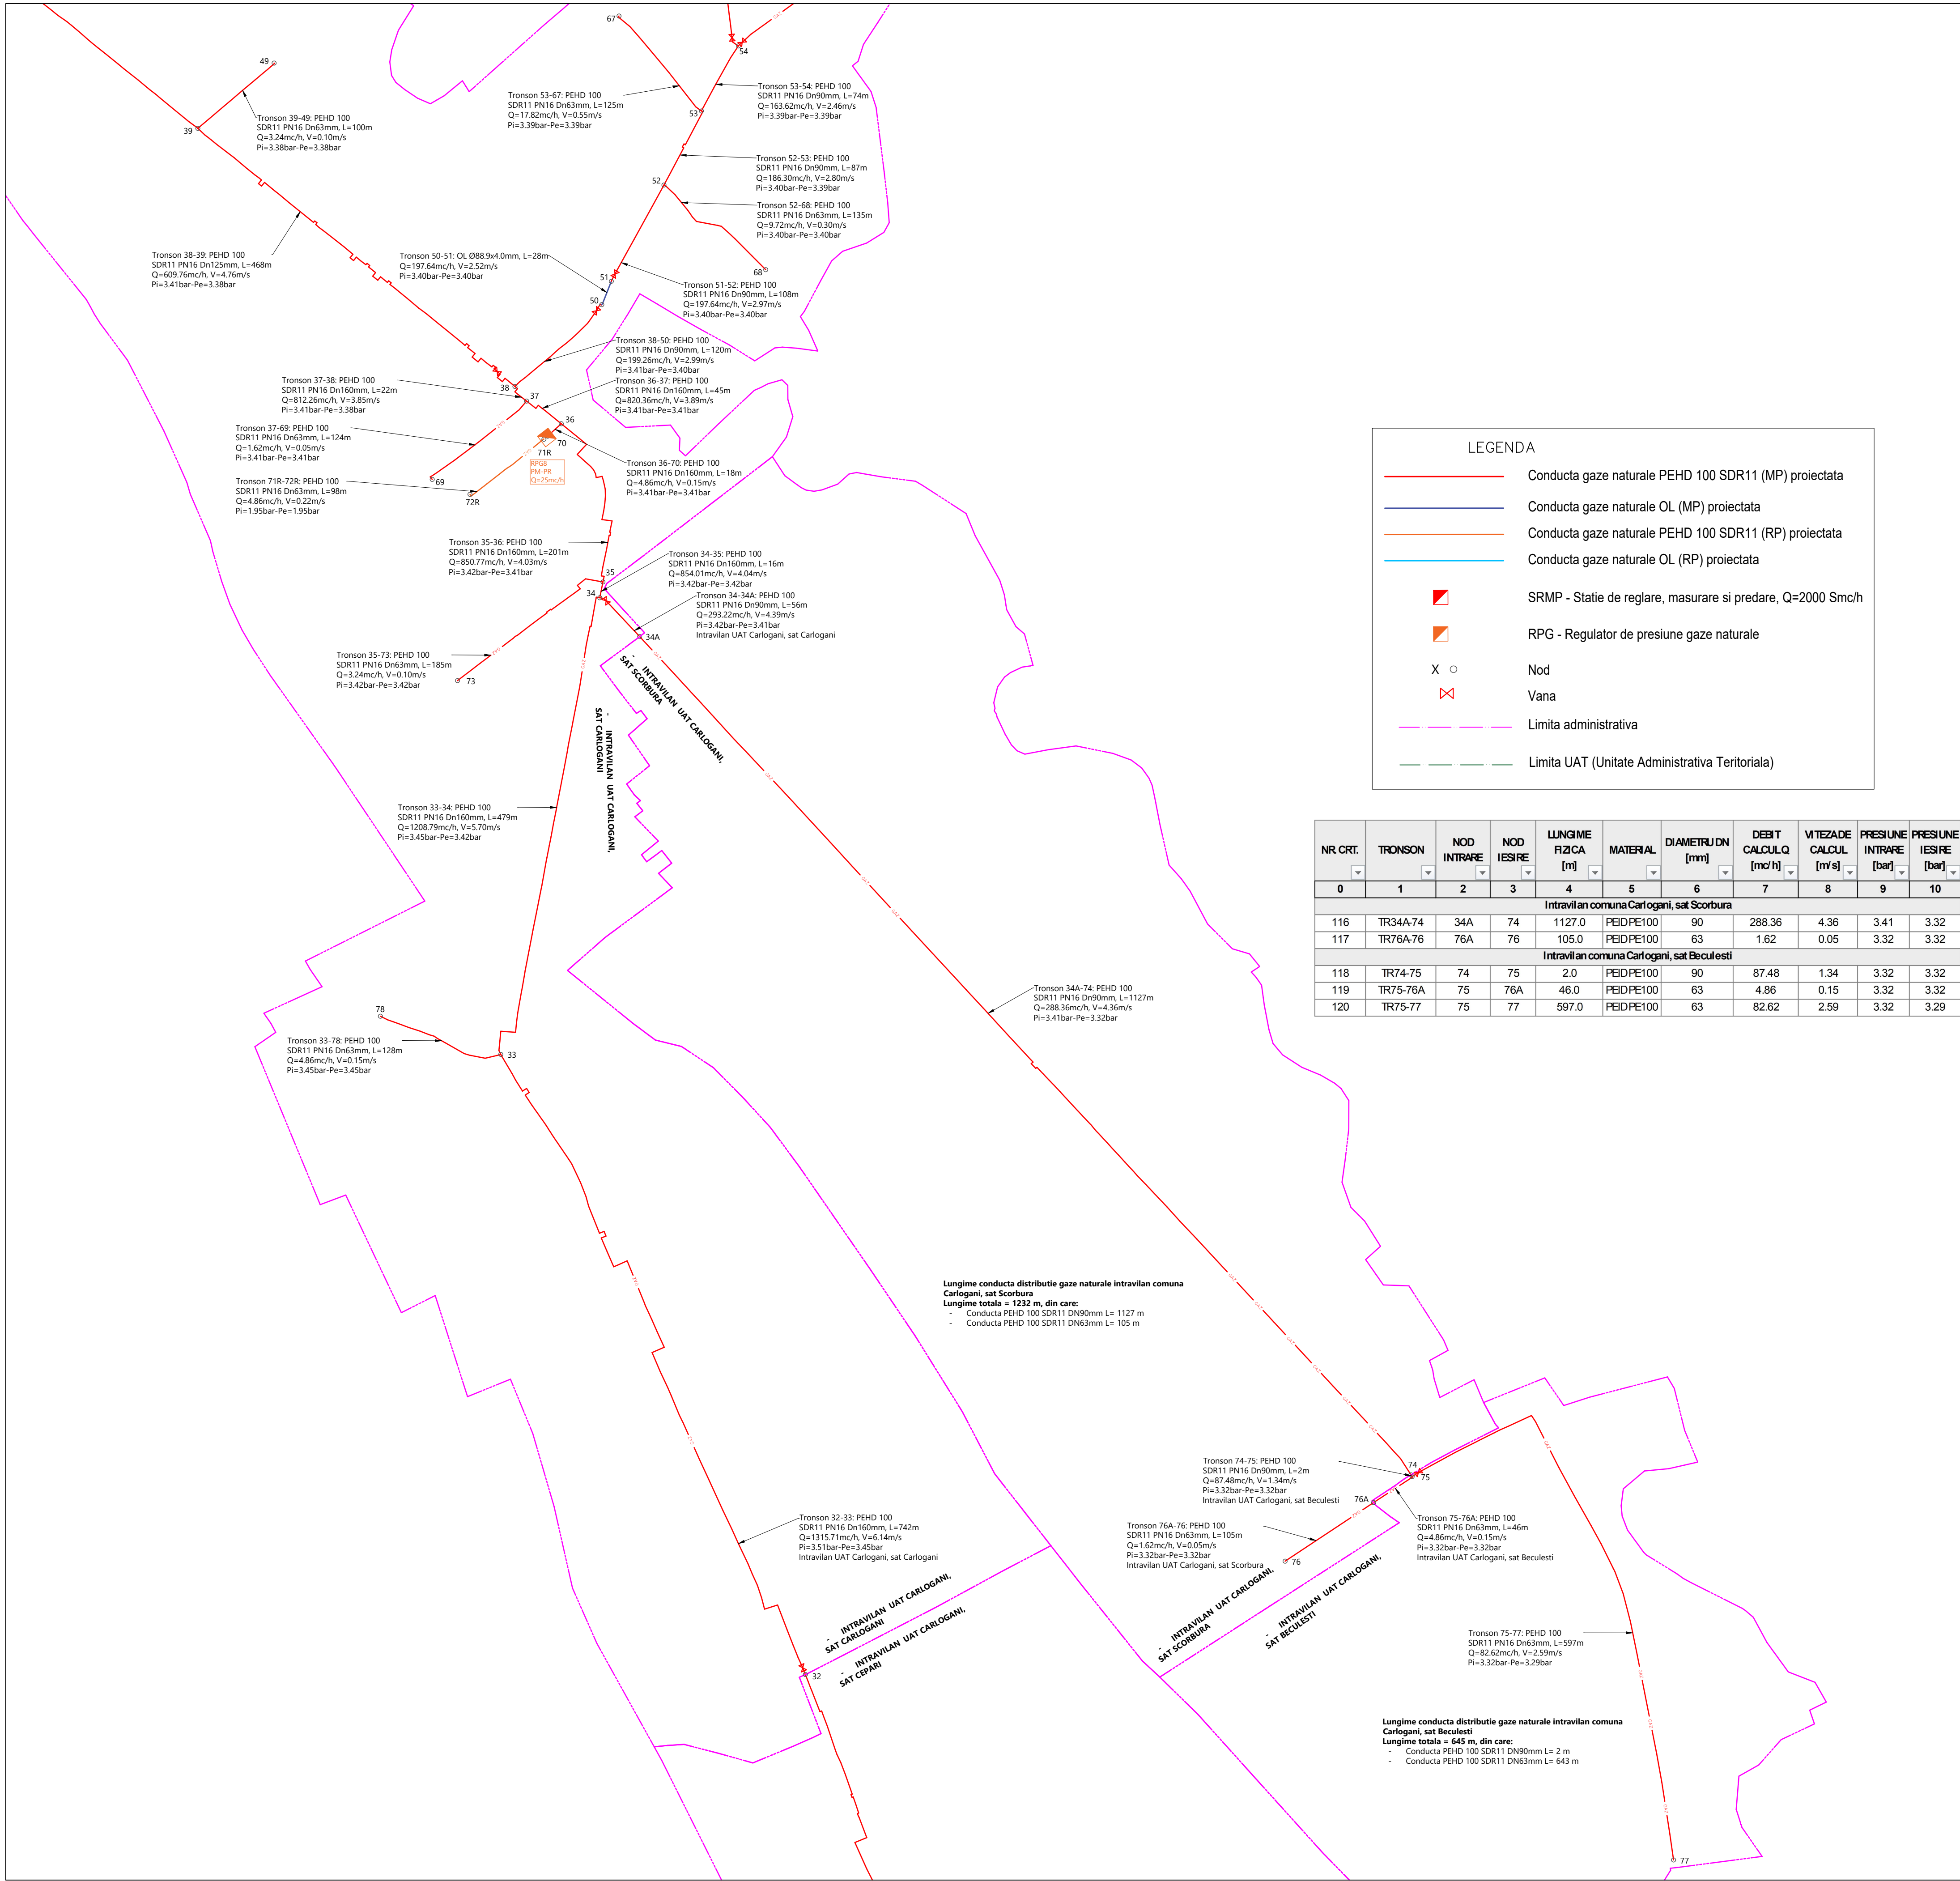

LEGENDA

Conducta gaze naturale PEHD 100 SDR11 (MP) proiectata

Conducta gaze naturale OL (MP) proiectata

Conducta gaze naturale PEHD 100 SDR11 (RP) proiectata

Conducta gaze naturale OL (RP) proiectata

SRMP - Statie de reglare, masurare si predare, Q=2000 Smc/h

RPG - Regulator de presiune gaze naturale

Nod

Vana

Limita administrativa

Limita UAT (Unitate Administrativa Teritoriala)

NR. CRT.	TRONSON	NOD INTRARE	NOD IESIRE	LUNGIME FIZICA [m]	MATERIAL	DIAMETRU DN [mm]	DEBIT CALCUL Q [mc/h]	VITEZA DE CALCUL [m/s]	PRESIUNE INTRARE [bar]	PRESIUNE IESIRE [bar]
0	1	2	3	4	5	6	7	8	9	10
Intravilan comuna Carlogani, sat Scorbura										
116	TR34A-74	34A	74	1127.0	PEHD PE100	90	288.36	4.36	3.41	3.32
117	TR76A-76	76A	76	105.0	PEHD PE100	63	1.62	0.05	3.32	3.32
Intravilan comuna Carlogani, sat Beculesti										
118	TR74-75	74	75	2.0	PEHD PE100	90	87.48	1.34	3.32	3.32
119	TR75-76A	75	76A	46.0	PEHD PE100	63	4.86	0.15	3.32	3.32
120	TR75-77	75	77	597.0	PEHD PE100	63	82.62	2.59	3.32	3.29

CATEGORIA DE IMPORTANTA A LUCRARII ESTE "C"
CONSTRUCTII DE IMPORTANTA NORMALA

FAZA DETERMINANTA
La efectuarea probei de presiune a retelei de gaze
naturale trebuie anuntat Inspectoratul Judetean in
Constructii.